ATTERBERG LIMITS TEST REPORT (ASTM D4318)

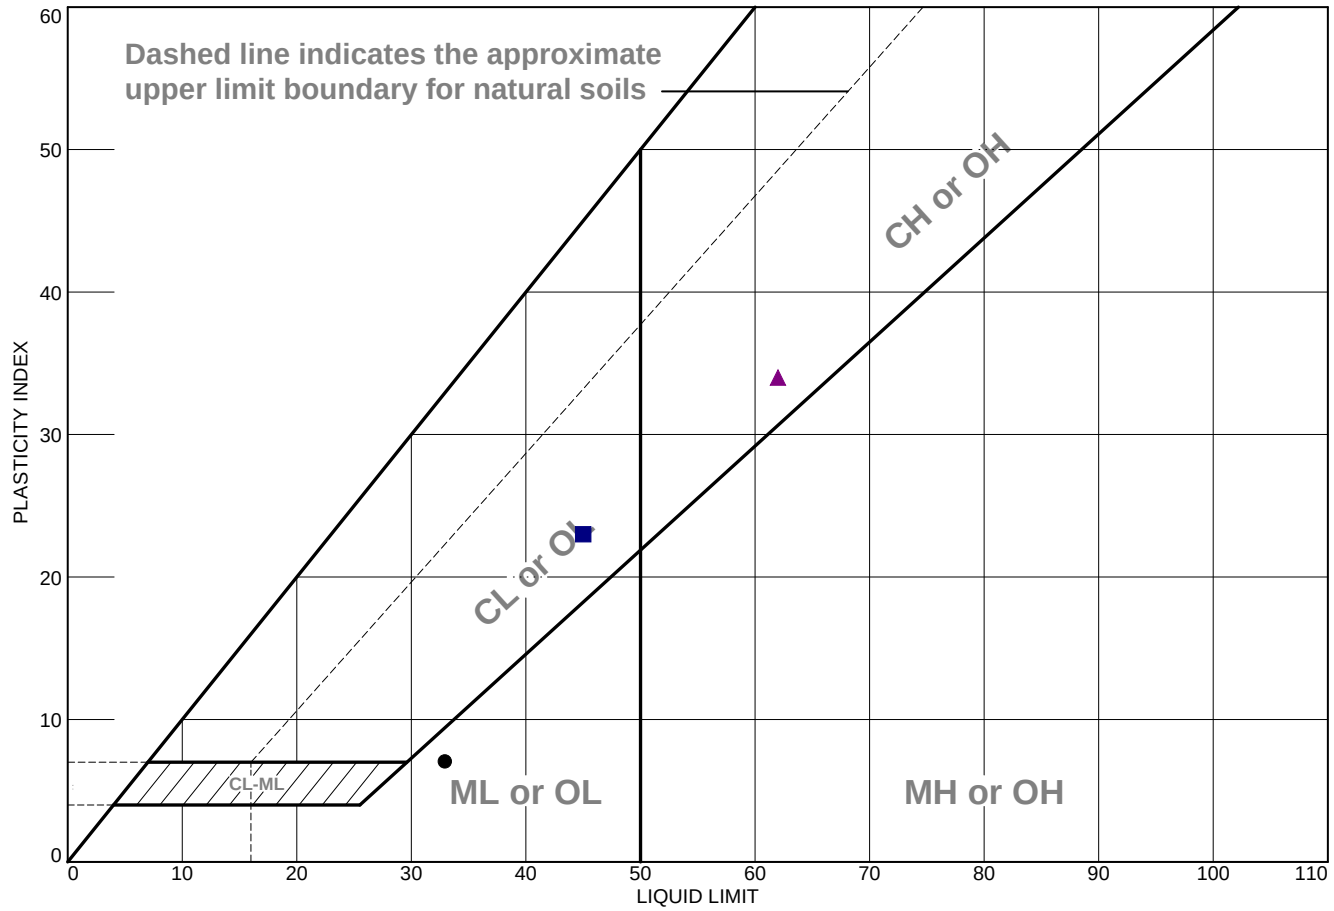

	MATERIAL DESCRIPTION	LL	PL	PI	%<#40	%<#200	USCS
●	Silt with Sand (ML), Brown mottled Gray	33	26	7	98	84	ML
■	Lean Clay (CL), Gray, Silty	45	22	23	99	97	CL
▲	Organic Clay (OH), Brown mottled Gray, Silty	62	28	34	100	99	(OH)

Project No. 18-3036 **Client:** Little Swan Lake

Project: Little Swan Lake - Siltation Project

●**Location:** Sample #1 (5/14/2018) **Sample Number:** 1

■**Location:** Sample #2 (5/14/2018) **Sample Number:** 2

▲**Location:** Sample #3 (5/14/2018) **Sample Number:** 3

Remarks:

●As Rec'd Moisture = 25.7%

■As Rec'd Moisture = 34.1%

▲As Rec'd Moisture = 90.9%

GEOTECHNICS
Soil & Material Testing
4510 Paris Gravel Road - Hannibal, MO

Figure

Tested By: BJJ **Checked By:** BJS